


EXTERNAL PRESSURE DESIGN IN CREEP RANGE

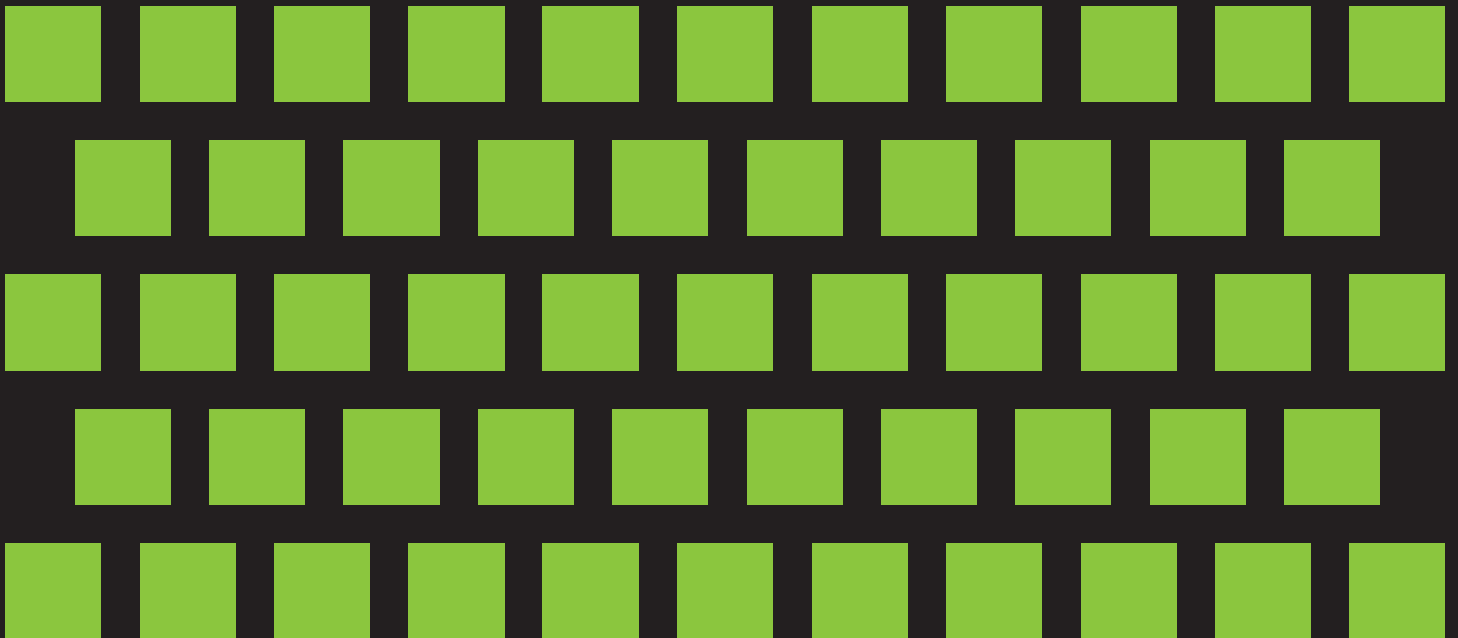

STP-PT-029-1

External Pressure Design in Creep Range

Prepared by:

Maan Jawad, Ph.D., P.E. and Donald Griffin, Ph.D.
Global Engineering & Technology, LLC



Date of Issuance: July 29, 2011

This report was prepared as an account of work sponsored by ASME Pressure Technologies Codes and Standards and the ASME Standards Technology, LLC (ASME ST-LLC).

Neither ASME, ASME ST-LLC, Global Engineering & Technology, LLC, nor others involved in the preparation or review of this report, nor any of their respective employees, members or persons acting on their behalf, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness or usefulness of any information, apparatus, product or process disclosed, or represents that its use would not infringe upon privately owned rights.

Reference herein to any specific commercial product, process or service by trade name, trademark, manufacturer or otherwise does not necessarily constitute or imply its endorsement, recommendation or favoring by ASME ST-LLC or others involved in the preparation or review of this report, or any agency thereof. The views and opinions of the authors, contributors and reviewers of the report expressed herein do not necessarily reflect those of ASME ST-LLC or others involved in the preparation or review of this report, or any agency thereof.

ASME ST-LLC does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a publication against liability for infringement of any applicable Letters Patent, nor assumes any such liability. Users of a publication are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Participation by federal agency representative(s) or person(s) affiliated with industry is not to be interpreted as government or industry endorsement of this publication.

ASME is the registered trademark of the American Society of Mechanical Engineers.

No part of this document may be reproduced in any form,
in an electronic retrieval system or otherwise,
without the prior written permission of the publisher.

ASME Standards Technology, LLC
Three Park Avenue, New York, NY 10016-5990

ISBN No. 978-0-7918-3398-8

Copyright © 2011 by
ASME Standards Technology, LLC
All Rights Reserved

Summary of Changes

July 29, 2011

STP-PT-029-1

External Pressure Design in Creep Range

The following changes have been made to the first revision of STP-PT-029.

<i>Rev. 1 Page</i>	<i>Location</i>	<i>Change</i>
vi-vii	Table of Contents	Updated to reflect changes
3	table 2, row 8	Corrected from “9Cr-1M0-V” to “9Cr-1Mo-V”
5	last paragraph, line 3	Replaced “ k' ” with “ $k'T$ ”
5	equation (10)	Removed “ T ”
6	paragraph 1	Inserted “ $K' = k'T$ ”
6	equation (11)	Replaced “1464” with “39,300”
6	equation (10)	Removed “ T ”
6	equation (11)	Replaced “1464” with “39,300”
7	bullet 2	Replaced “48” with “120”
7	bullet 3	Replaced “10,000” with “100,000”
7	section 3.3.1.1, line 3	Replaced “10,000” with “100,000”
7	section 3.3.1.1, line 3	Replaced “860” with “8,600”
7	equation	Removed “100”
7	equation	Replaced “48” with “120”
7	equation	Replaced “5,880” with “94,100”
7	equation	Replaced “<” with “>”
7	paragraph 8	Replaced “5,880” with “14,200”
7	paragraph 8	Replaced “860” with “8,600”

<i>Rev. / Page</i>	<i>Location</i>	<i>Change</i>
7	section 3.3.1.2, line 3	Replaced “10,000” with “100,000”
7	section 3.3.1.2, line 3	Replaced “380” with “3,800”
8	first equation	Removed “10,000”
8	first equation	Replaced “48” with “120”
8	first equation	Replaced “515” with “5,570”
8	paragraph 3	Replaced “515” with “5,570”
8	paragraph 3	Replaced “380” with “3,800”
8	section 3.3.1.3, line 1	Replaced “40” with “20”
8	section 3.3.1.3, line 2	Replaced “300” with “3,800”
8	second equation	Removed “100,000”
8	second equation	Replaced “48” with “120”
8	second equation	Replaced “2.94” with “2.96”
8	second equation	Replaced “300” with “4,740”
8	paragraph 9	Replaced “300” with “4,740”
8	paragraph 9	Replaced “equal to” with “greater than”
8	paragraph 9	Replaced “300” with “3,800”
8	paragraph 9	Replaced “40” with “20”
11	equation (19)	Replaced “ K' ” with “ k' ”
11	paragraph 5	Replaced “ K' ” with “ k' ”
11	paragraph 5	Replaced “(2)” with “(1)”
12	equation (20)	Removed “ T ”
12	paragraph 1	Inserted “ $K' = k'T$ ”
13	bullet 4	Replaced “24.7” with “24,700”
13	paragraph 5	Removed “8”
14	paragraph 4	Removed “8”
15	bullet 3	Inserted “S = 20,700 psi at 1000°F for short time”
15	bullet 4	Inserted “S = 6,300 psi at 1000°F for 100,000 hours”
15	bullet 6	Replaced “1.0” with “1.5”
15	paragraph 4	Inserted “This stress is < 20,700 psi and”
15	last equation	Removed “100,000”
15	paragraph 7	Replaced “395 <” with “12,300 psi > 6,300 psi. Use B = 6,300 psi >”
15	paragraph 8	Removed “not”
16	paragraph 3	Replaced “low” with “high”

<i>Rev. / Page</i>	<i>Location</i>	<i>Change</i>
16	bullet 1	Inserted “The ratio e/t of the cylinder is highly arbitrary and does not have an influence on the results.”
16	bullet 1	Removed “assumed to have a very large R_o/t ratio. However, the ratio in this case is only 45.”
16	bullet 2	Replaced “get to be too conservative” with “become approximate”
16	paragraph 4	Removed “the conservative”
18	equation (29)	Replaced “ K' ” with “ k' ”
18	paragraph 5	Replaced “ K' ” with “ k' ”
18	paragraph 5	Replaced “(2)” with “(1)”
19	equation (30)	Removed “ T ”
19	paragraph 1	Inserted “ $K' = k'T$ ”
20	paragraph 4	Replaced “1.0” with “1.5”
21	first equation	Replaced “1.0” with “1.5”
21	first equation	Removed “100,000”
21	first equation	Replaced “0.55” with “16.9”
21	paragraph 2	Replaced “0.55 psi <” with “16.9 psi >”
21	paragraph 3	Replaced “inadequate” with “adequate”
21	bullet 1	Inserted “The ratio e/t of the cylinder is highly arbitrary and does not have an influence on the results.”
21	bullet 1	Removed “assumed to have a very large D_o/t ratio. However, the ratio in this case is only 144.”
21	bullet 2	Replaced “get to be too conservative” with “become approximate”
23	equation (40)	Replaced “ P_a ” with “ σ_c ”
23	equation (40)	Removed “ T ”
23	equation (40)	Replaced “0.588” with “0.353”

TABLE OF CONTENTS

Foreword.....	viii
Abstract.....	ix
1 INTRODUCTION.....	1
2 STRESS-STRAIN RELATIONSHIPS IN THE CREEP RANGE.....	2
3 AXIAL COMPRESSION OF TUBES AND COLUMNS.....	4
3.1 Theoretical Derivations.....	4
3.2 Design Equations.....	6
3.3 Applications.....	7
3.3.1 Example 1.....	7
4 AXIAL COMPRESSION OF CYLINDRICAL SHELLS.....	9
4.1 Theoretical Equations Below the Creep Range.....	9
4.1.1 Elastic Buckling.....	9
4.1.2 Inelastic Buckling.....	10
4.2 Theoretical Equations in the Creep Range.....	11
4.3 Approximate Method Using Isochronous Stress-Strain Curves in the Creep Range.....	12
4.4 Design Equations.....	14
4.5 Applications.....	14
4.5.1 Example 2.....	14
5 EXTERNAL PRESSURE ON CYLINDRICAL SHELLS.....	17
5.1 Theoretical Equations Below the Creep Range.....	17
5.2 Theoretical Equations in the Creep Range.....	18
5.3 Approximate Method Using Isochronous Stress-Strain Curves.....	19
5.4 Design Equations.....	19
5.5 Applications.....	20
5.5.1 Example 3.....	20
6 EXTERNAL PRESSURE ON SPHERICAL SHELLS.....	22
6.1 Theoretical Equations Below the Creep Range.....	22
6.2 Theoretical Equations in the Creep Range.....	22
6.3 Approximate Method Using Isochronous Stress-Strain Curves.....	23
6.4 Design Equations.....	23
6.5 Applications.....	24
6.5.1 Example 4.....	24
7 EXTERNAL PRESSURE ON CONICAL SHELLS.....	26
References.....	33
Acknowledgments.....	35
Abbreviations and Acronyms.....	36

LIST OF TABLES

Table 1 - Approximate Temperatures at Which Creep Becomes a Design Consideration for Various Materials (these temperatures may vary significantly for specific product chemistry and failure mode under consideration).	1
Table 2 - Temperature Range of Available Isochronous Stress-Strain Curves.	3

LIST OF FIGURES

Figure 1 - Creep Curves Conventionally Plotted as Strain vs Time at Constant Stress.	27
Figure 2 - Resultant Stress-Strain Curves Plotted as Stress vs Strain at Constant Time.	27
Figure 3 - Isochronous Stress-Strain Curves for 2.25Cr-1Mo Steel at 1000°F (ASME).	28
Figure 4 - Deflection in the Creep Range.	29
Figure 5 - External Pressure Chart for Carbon and Low-Alloy Steels with Yield Stresses of 30 ksi and Higher (ASME).	29
Figure 6 - External Pressure Chart for 2.25Cr-1Mo Steel at 1000°F.	30
Figure 7 - Collapse Coefficients of Cylindrical Shells with Pressure on Sides and Ends, Edges Simply Supported, and $\mu = 0.3$ [3].	31
Figure 8 - Geometric Chart for Cylindrical Shells Under External or Compressive Loadings (ASME).	32

FOREWORD

This document was developed under a research and development project that resulted from ASME Pressure Technology Codes & Standards (PTCS) committee requests to identify, prioritize and address technology gaps in current or new PTCS Codes, Standards and Guidelines. This project is one of several included for ASME fiscal year 2009 sponsorship which are intended to establish and maintain the technical relevance of ASME codes & standards products. The specific project related to this document is project 09-03 (BPVC #2) titled “External Pressure Design in Creep Range”.

Established in 1880, the American Society of Mechanical Engineers (ASME) is a professional not-for-profit organization with more than 127,000 members promoting the art, science and practice of mechanical and multidisciplinary engineering and allied sciences. ASME develops codes and standards that enhance public safety, and provides lifelong learning and technical exchange opportunities benefiting the engineering and technology community. Visit www.asme.org for more information.

The ASME Standards Technology, LLC (ASME ST-LLC) is a not-for-profit Limited Liability Company, with ASME as the sole member, formed in 2004 to carry out work related to newly commercialized technology. The ASME ST-LLC mission includes meeting the needs of industry and government by providing new standards-related products and services, which advance the application of emerging and newly commercialized science and technology and providing the research and technology development needed to establish and maintain the technical relevance of codes and standards. Visit www.stllc.asme.org for more information.

ABSTRACT

At the present time the ASME Boiler and Pressure vessel code does not include rules for the design of components under external pressure and axial compressive loads in the time-dependent creep regime. A method is suggested in this report for designing components in the time-dependent creep regime. The design methodology is developed for columns and cylindrical shells under axial compression as well as cylindrical, spherical and conical shells under external pressure. An external pressure chart for 2.25Cr-1Mo steel was developed at 1000°F to demonstrate the applicability of the methods developed in this report. In addition, variable factors of safety are imbedded in the design equations in order to transition from the design factors used in the time-independent External Pressure Charts of Section II to the lower design factors specified in Section III for time-dependent, creep buckling.

INTENTIONALLY LEFT BLANK

1 INTRODUCTION

The 2007 edition of the ASME Boiler and Pressure Vessel Code, Sections I and VIII, includes rules for the design of cylindrical, conical, spherical, ellipsoidal and torispherical shells subjected to external pressure. Rules are also given for the design of cylindrical and conical shells under axial compressive loads. In addition, Section VIII gives rules for the design of structural members subjected to axial compressive loads such as heat exchanger tubes. All of these rules are applicable at temperatures below the creep range of the material. The ASME code gives approximate temperatures above which creep becomes prominent as shown in Table 1. These temperature limits are approximate and serve as guidelines for design purposes and should not be thought of as absolute values for a given specified material.

Table 1 - Approximate Temperatures at Which Creep Becomes a Design Consideration for Various Materials (these temperatures may vary significantly for specific product chemistry and failure mode under consideration).

Material	Temperature (°F)	Temperature (°C)
Carbon and Low Alloy Steel	700-900	370-480
Stainless Steels	800-1000	425-535
Aluminum Alloys	300	150
Copper Alloys	300	150
Nickel Alloys	900-1100	480-595
Titanium and Zirconium Alloys	600-650	315-345

There are situations where it is beneficial for newly constructed boiler and pressure vessel components to operate at temperatures beyond the creep cut-off limits of the material. Thus, new design criteria are needed for establishing allowable compressive stress for various components. In this report, suggested procedures are presented to address the design of ASME components under compressive and external pressure loads operating at elevated temperatures in the creep range.