




DEVELOPMENT OF WELD  
STRENGTH REDUCTION  
FACTORS AND WELD JOINT  
INFLUENCE FACTORS FOR  
SERVICE IN THE CREEP  
REGIME AND APPLICATION  
TO ASME CODES

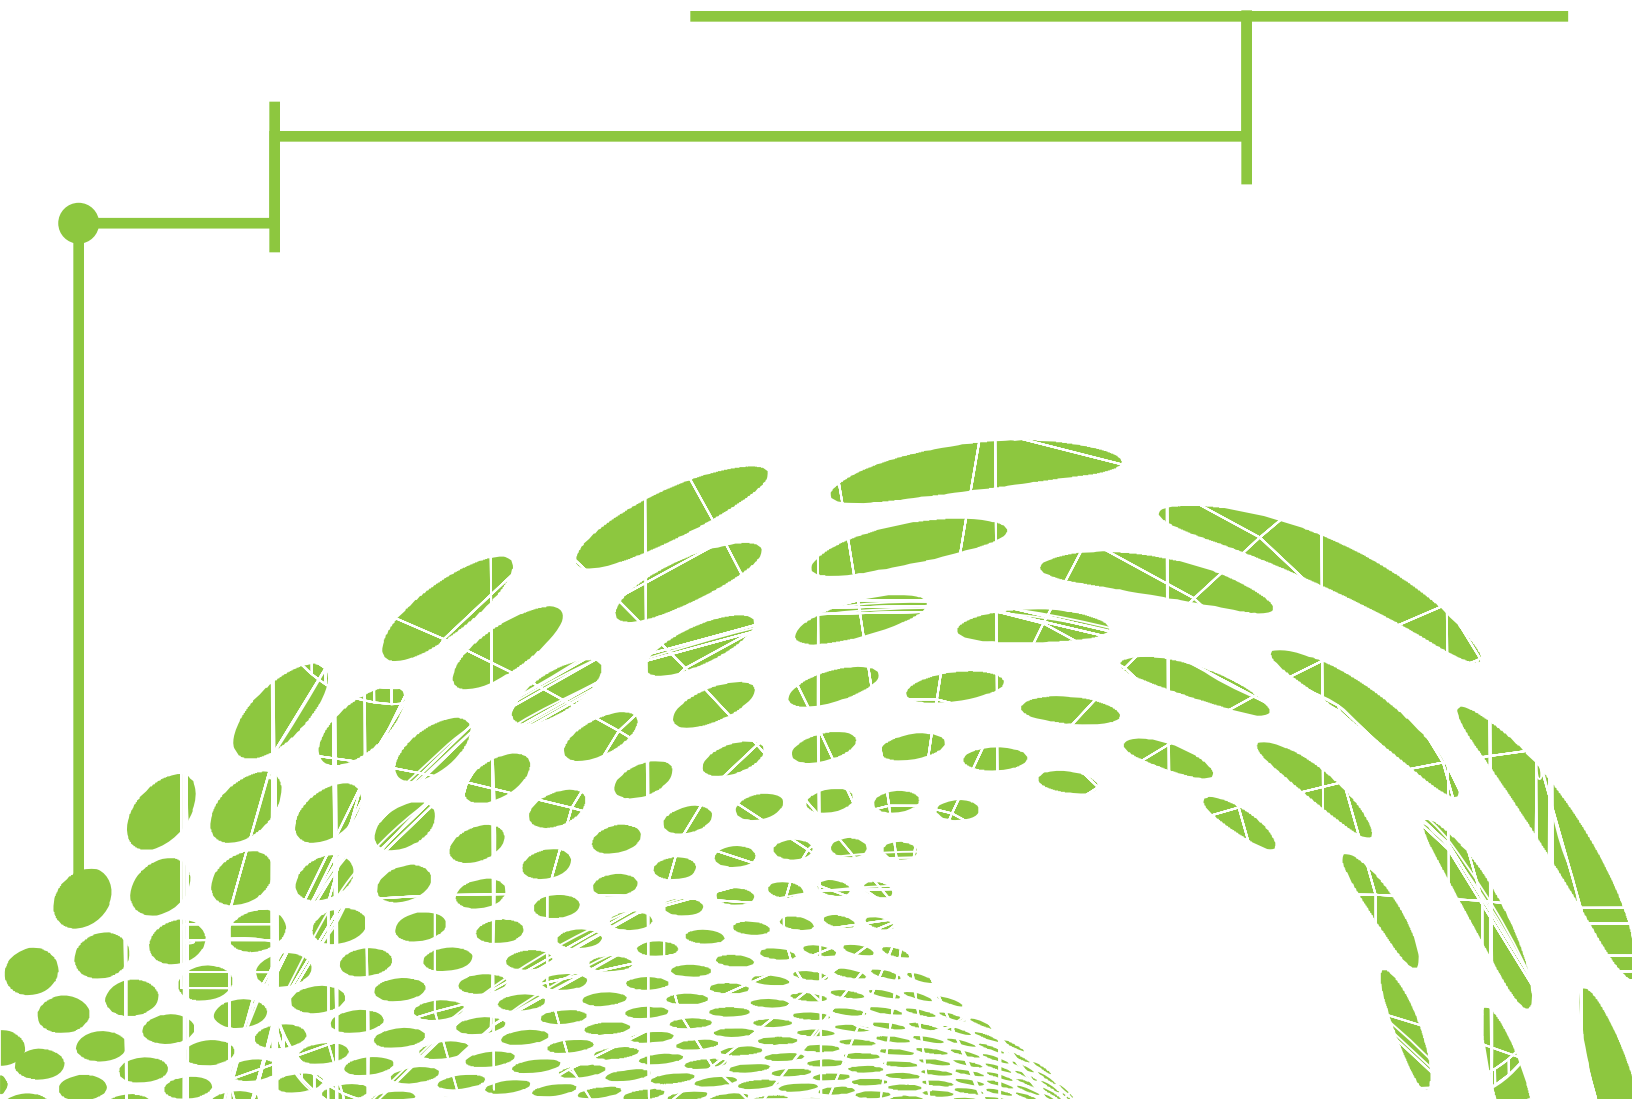

STP-PT-077

**DEVELOPMENT OF WELD  
STRENGTH REDUCTION  
FACTORS AND WELD JOINT  
INFLUENCE FACTORS FOR  
SERVICE IN THE CREEP REGIME  
AND APPLICATION TO ASME  
CODES**

*Prepared by:*

J. Shingledecker, Electric Power Research Institute  
B. Dogan, Electric Power Research Institute  
J. Foulds, Clarus Consulting, LLC  
R. Swindeman, Cromtech, Inc.  
D. Marriott, Stress Engineering Services  
P. Carter, Stress Engineering Services

The logo for ASME Standards Technology, LLC features a stylized, light gray swoosh that curves around the text. The text is arranged in two lines: "ASME STANDARDS" on the top line and "TECHNOLOGY, LLC" on the bottom line. The "A" in "ASME" is stylized with a horizontal line through it.

ASME STANDARDS  
TECHNOLOGY, LLC

Date of Issuance: June 26, 2017

This publication was prepared by ASME Standards Technology, LLC (“ASME ST-LLC”) and sponsored by The American Society of Mechanical Engineers (“ASME”) and the Electric Power Research Institute (“EPRI”).

Neither ASME, ASME ST-LLC, the author, nor others involved in the preparation or review of this publication, nor any of their respective employees, members or persons acting on their behalf, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness or usefulness of any information, apparatus, product or process disclosed, or represents that its use would not infringe upon privately owned rights.

Reference herein to any specific commercial product, process or service by trade name, trademark, manufacturer or otherwise does not necessarily constitute or imply its endorsement, recommendation or favoring by ASME ST-LLC or others involved in the preparation or review of this publication, or any agency thereof. The views and opinions of the authors, contributors and reviewers of the publication expressed herein do not necessarily reflect those of ASME ST-LLC or others involved in the preparation or review of this publication, or any agency thereof.

ASME ST-LLC does not take any position with respect to the validity of any patent rights asserted in connection with any items mentioned in this document, and does not undertake to insure anyone utilizing a publication against liability for infringement of any applicable Letters Patent, nor assumes any such liability. Users of a publication are expressly advised that determination of the validity of any such patent rights, and the risk of infringement of such rights, is entirely their own responsibility.

Participation by federal agency representative(s) or person(s) affiliated with industry is not to be interpreted as government or industry endorsement of this publication.

ASME is the registered trademark of the American Society of Mechanical Engineers.

No part of this document may be reproduced in any form,  
in an electronic retrieval system or otherwise,  
without the prior written permission of the publisher.

ASME Standards Technology, LLC  
Two Park Avenue, New York, NY 10016-5990

ISBN No. 978-0-7918-7126-3  
Copyright © 2017 by  
ASME Standards Technology, LLC  
All Rights Reserved

## TABLE OF CONTENTS

Foreword.....	ix
PART 1: Development and Application of Weld Strength Reduction Factors Guideline.....	1
1 APPLICATION GUIDELINE .....	2
1.1 Overview.....	2
1.2 Application Guideline.....	4
1.2.1 Step 1: Develop Database .....	5
1.2.2 Step 2: Analyze Data .....	6
1.2.3 Step 3: Base Material Strength Factor .....	7
1.2.4 Step 4: Application to Welded Structure .....	8
1.2.5 Step 5: Design Strength Ratio.....	9
1.3 New Materials.....	10
1.3.1 Comments on Specimen Size.....	10
1.3.2 Data Requirements.....	11
2 APPLICATION TO CHROMIUM-MOLYBDENUM LONGITUDINAL SEAM WELDS .....	13
2.1 Step 1: Grade 22 Database & Step 2 Pre-Analysis .....	13
2.1.1 Base Metal .....	13
2.1.2 Weld Metal .....	13
2.1.3 Cross-Weld Data.....	13
2.2 Step 2: Grade 22 Data Analysis .....	16
2.2.1 Base Metal Data Analysis.....	16
2.2.2 Weld Metal Data Analysis .....	16
2.2.3 Cross-Weld Specimen Data Analysis .....	18
2.2.4 Summary .....	20
2.3 Step 3: Extracting the Base Metal Strength Factor from Cross-Weld Tests.....	21
2.4 Step 4: Testing Assumptions .....	25
2.5 Step 5: Application to Seam Weld Structure .....	25
2.6 Step 6: Summary and Implications for WSRFs.....	30
3 APPLICATION TO SUBCRITICALLY HEAT-TREATED GRADE 91 SEAM WELDS .....	32
3.1 Step 1: (Database) & Step 2 Pre-Analysis (Analyze Data).....	32
3.2 Step 2: (Analyze Data) Development of Trend Curves .....	38
3.3 Step 3: Extracting the Base Material Strength Factor.....	44
3.4 Step 4: Testing Assumptions Against Non-Standard Specimens .....	47
3.4.1 Masuyama Specimens.....	47
3.4.2 EPRI Large Specimens .....	50
3.5 Step 5: Application to Welded Structures.....	52
3.6 Step 6: (Design Strength Ratio) Summary & Implications for WSRFs.....	57
4 OVERALL PROJECT SUMMARY AND FINDINGS.....	59
References – Part 1 .....	62
PART 2: Literature Review, Industry Approach, and Data Compilation in Support of WSRF Development .....	63
1 INTRODUCTION.....	64
2 CREEP FAILURES IN SEAM-WELDED COMPONENTS .....	65
2.1 CrMo Power Plant Seam-Welded Piping Experience.....	65
2.1.1 Failures and Major Cracking .....	65

2.1.2	Cracking and Damage from Inspections.....	69
2.2	Creep Strength Enhanced Ferritic Steels Long-Seam Experience.....	69
2.3	Process Plant Long-Seam Experience.....	71
2.3.1	Refinery Catalytic Reformer Piping Failure.....	71
2.3.2	Comment.....	72
2.4	Implications to WSRF.....	72
2.4.1	Damage and Failure Rate.....	73
2.4.2	Perspective on CrMo Failure Experience.....	75
3	CURRENT DESIGN PRACTICES FOR WELD STRENGTH REDUCTION FACTORS.....	77
3.1	ASME Approach: Section III N-H.....	77
3.1.1	Section III N-H.....	77
3.2	ASME Approach: Section I and B31.....	78
3.2.1	Background on Universal ‘Presumptive’ Factor.....	78
3.2.2	Development of WSRFs for Section I, B31.1, and B31.3.....	79
3.3	European Practices.....	82
3.3.1	Practices of Determination and Use of WSRF in European Countries.....	82
3.3.2	The ECCC Approach on Determination of WSRF.....	85
3.3.3	WSRF in European Codes.....	86
4	DATABASE OF WELD AND WELDMENT CREEP-RUPTURE PROPERTIES.....	90
4.1	Carbon Steel.....	90
4.1.1	Summary of Data.....	90
4.1.2	Qualitative Observations.....	91
4.1.3	Analysis of Data.....	91
4.1.4	Weld Metal Behavior.....	94
4.1.5	Summary.....	95
4.2	Chromium-Molybdenum Steels (Gr. 11 & 22).....	96
4.2.1	Database.....	96
4.2.2	Summary of Observations.....	97
4.3	308 Stainless Steel Weld Metal and 304/308 Stainless Steel Weldment Stress-Rupture Data.....	97
4.3.1	Review of Studies.....	97
4.3.2	Summary of the Database on the Stress-Rupture of 304H/308 Stainless Steel Filler Metals and Weldments.....	102
4.4	316H & 16-8-2 Weld Metal.....	112
4.4.1	Review of Research on the Stress-Rupture of 316 and 16-8-2 Stainless Steel Filler Metals and Weldments.....	112
4.4.2	Review of the Database on the Stress-Rupture of 316 and 16-8-2 Stainless Steel Filler Metals and Weldments.....	114
4.4.3	A Brief Review of the Determination of Stress Rupture Factors for 316 and 16-8-2.....	116
4.5	Alloy 800/800H.....	116
4.5.1	Identification of Alloy 800/800H Filler Metals and Weldment Stress-Rupture Data.....	116
4.5.2	Review of Research on the Stress-Rupture of Filler Metals and Weldments.....	118
4.5.3	Assembly of the Stress-Rupture Database.....	120
4.6	Review of 9Cr-1Mo-V (Grade 91) Steel Weld Metal and Weldments Creep-Rupture Data and Weld Strength Reduction Factors.....	121
4.6.1	Background and Data Sources.....	121
4.6.2	Characteristics of the Gr. 91 Weld and Weldment Database.....	122
4.6.3	Review of Reports and Papers on WSRFs for Grade 91.....	124
5	SUMMARY.....	127

References – Part 2 .....	228
PART 3: Development of Weld Joint Influence Factors .....	239
Summary .....	240
1 INTRODUCTION.....	241
2 DESCRIPTION OF WORKSCOPE .....	243
2.1 Weldment Model Development.....	243
2.2 Computation of Weld Joint Influence Factors .....	243
2.3 Assessment of Test Specimen Geometry.....	244
3 DETAILS OF WORK PERFORMED .....	245
3.1 Weldment Model Development.....	245
3.1.1 Subtask 2-1: Review the Prior History on Weldment Modeling .....	245
3.1.2 Subtask 2-2: Selection of Suitable Material Constitutive and Failure Models .....	245
3.1.3 Subtask 2-3: Synthesis of Weld Sub-Region Properties.....	247
3.1.4 Subtask 2-4: Methodology for the Analysis of Weldment Deformation and Failure.....	248
3.1.5 Methodology Development in Summary .....	251
3.2 Computation of Weld Joint Influence Factors .....	251
3.3 Cross-Weld Tests .....	253
4 RESULTS.....	255
4.1 Concepts.....	255
4.2 Numerical Predictions.....	256
4.2.1 WJIF Calculations.....	256
5 CONCLUSIONS .....	259
References – Part 3 .....	364

## LIST OF FIGURES

Figure 1: Summary of the Ratio of Stress to Cause Rupture to the Calculated Minimum Stress from ASME Section III-NH (formerly N-47) Rules as a Function of Rupture Time for Structural Feature Tests on 316, 304, and 2 1/4Cr-1Mo Showing All Ratios, Regardless Of Material and Rupture Time, Are Greater Than 1, i.e. the Calculated Stresses Are Conservative [2].	3
Figure 2: Box Chart Describing the Application of the Data and Methods in This Project for Developing the Information Needed by ASME Code Sections for Determining Weld Strength Reduction Factors.....	5
Figure 3: Information Required for Development of a Database .....	5
Figure 4: Details of Pre-Analysis in Step 2 with Highlighted Data Used for the First Analysis .....	7
Figure 5: Detail of Process to Determine the Inherent Material Strength Factor From Cross-Weld Tests .....	8
Figure 6: Minimum Proposed Data Requirements for Weld Metal and Weldment Test Data to Facilitate Analysis for This Project.....	12
Figure 7: Grade 22 Base Metal Stress Rupture Data from EPRI TR-110807 [10] .....	14
Figure 8: Grade 22 Weld Metal Stress Rupture Data from EPRI TR-110807 [10] .....	15
Figure 9: Grade 22 Cross-Weld (X-W) Specimen Stress Rupture Data from EPRI TR-110807 [10].	15
Figure 10: Grade 22 Base Metal (BM) Specimen Stress Rupture Data at $\leq 20$ ksi from EPRI TR-110807 [10] and the Corresponding Spera Function Curve-Fit.....	17
Figure 11: Grade 22 Weld Metal (WM) Specimen Stress Rupture Data at $\leq 20$ ksi from EPRI TR-110807 [10] and the Corresponding Spera Function Curve-Fit.....	18

Figure 12: Grade 22 Cross-Weld (X-W) Data and Best-Fit Spera Curve for Specimens Exhibiting Failure in WM, FL, WM/FL and the HAZ .....	19
Figure 13: Grade 22 Cross-Weld (X-W) Data and Best-Fit Spera Curve for Specimens Exhibiting Failure in WM, FL, WM/FL and the HAZ and Tested at $\leq 20$ ksi .....	20
Figure 14: Grade 22 BM, WM and Cross-Weld (X-W) Best-Fit Behavior as Derived from the EPRI Database .....	21
Figure 15: Maximum Principal Stress Distribution for 2:1 Weak Zone : Specimen Diameter Ratio (Assumed Cross-Weld Sample Geometry) .....	23
Figure 16: Maximum Principal Stress Distribution for 1:1 Weak Zone : Specimen Diameter Ratio .....	23
Figure 17: Results of Matching Cross-weld and Base Metal Rupture Data .....	24
Figure 18: Predicted Sample Size Effect Showing Strengthening and Weakening Behavior .....	24
Figure 19: Comparison of Factored Base Metal, Cross-weld and Weld Metal Strength Trend Lines .....	25
Figure 20: Seamweld model: Pipe OD = 762 mm, ID = 457 mm, weld semi-angle = 50 .....	26
Figure 21: Distribution of Plastic Strain Prior to Collapse .....	27
Figure 22: Distribution of MPS Prior to Collapse .....	27
Figure 23: Development of Max. Weld MPS to OD with Inelastic Strain and Time .....	28
Figure 24: Calculation of Joint WSRF: Single Sided “U” Weld .....	28
Figure 25: “X-Groove” Weld Geometry in 20” OD x 0.76” Thick Pipe .....	29
Figure 26: Distribution of Maximum Principal Stress Due to Inelastic Strain in Weld Metal .....	29
Figure 27: Calculation of Joint WSRF: “X-Groove” Configuration .....	29
Figure 28: Summary Plot of CrMo Steel Weldment Reduction Factors .....	31
Figure 29: Failure Locations as a Function of Test Stress and Temperature for Grade 91 Weld/Weldment Creep-Rupture Database .....	33
Figure 30: Failure Locations as a Function of Rupture Life and Temperature for Grade 91 Weld/Weldment Creep-Rupture Database .....	34
Figure 31: Suggested Regions Where Type IV/HAZ Failures Occur for Grade 91 Weldments .....	34
Figure 32: Larson-Miller Parameter (C=28.944) Comparison of Grade 91 Base Metal Average and Minimum Curves to Cross-Welds with Base Metal Cross-Weld Failures Identified .....	35
Figure 33: Larson-Miller Parameter (C=28.944) Comparison of Grade 91 Base Metal Average and Minimum Curves to Cross-Welds with Weld Metal Failures and All Weld Metal Test Data Identified .....	36
Figure 34: Larson-Miller Parameter (C=28.944) Comparison of Grade 91 Base Metal Average and Minimum Curves to Cross-Welds with Fusion Line Failures Identified .....	37
Figure 35: Larson-Miller Parameter (C=28.944) Comparison of Grade 91 Base Metal Average and Minimum Curves to Cross-Welds with Type IV/HAZ Failures Identified .....	38
Figure 36: LMP Plot for Grade 91 Base Metal Average and Minimum Curves with the Weld Metal Fit Curve Plotted .....	39
Figure 37: Comparison of Expected and Measured Rupture Life for Fit of HAZ/Type IV Failures ..	40
Figure 38: LMP Plot (Optimized C=24.859) of the HAZ/Type IV Data Curve-Fit Result .....	40
Figure 39: Regression Constants for Equation (1) Time-Temperature Analysis for Grade 91 Developed by Evaluation of the Database .....	41
Figure 40: Comparison of Predictions in Figure 39 Plotted with Data at 550°C .....	42
Figure 41: Comparison of Predictions in Figure 39 Plotted with Data at 593°C .....	42
Figure 42: Comparison of Predictions in Figure 39 Plotted with Data at 600°C .....	43
Figure 43: Comparison of Predictions in Figure 39 Plotted with Data at 649/650°C .....	44
Figure 44: Stress (MPa) for 100,000 Hour Predicted Average Rupture Life for Grade 91 Base Metal and HAZ-Type IV Failures .....	44
Figure 45: Distribution of Maximum Principal Stress (MPS) in the Weak HAZ of the 0.25” Diameter Cross-weld Tensile Specimen for 66 MPa Tension .....	45
Figure 46: Comparison of Average HAZ and Other Trendlines with Predicted Cross-weld Behavior (550°C) Using a Base Metal Strength Factor =0.95 .....	46

Figure 47: Comparison of Average HAZ and Other Trendlines with Predicted Cross-weld Behavior (600°C) Using a Base Metal Strength Factor =0.85. ....	46
Figure 48: Comparison Of Average HAZ And Other Trendlines With Predicted Cross-weld Behavior (650°C) Using A Base Metal Strength Factor =0.82 .....	47
Figure 49: Large U and X-Groove Specimens Evaluated by Masuyama [17].....	48
Figure 50: Test Results for Large Cross-Weld Specimens Tested at 650°C-66MPa [17].....	49
Figure 51: Limit Analysis of Masuyama 32 mm x 40 mm Tensile Specimen Showing the Predicted Weak Zone MPS Failure Location on the Center (Symmetry) Plane .....	49
Figure 52: Calculated Changes in Stress for the Two Cross-weld Specimens Considered .....	50
Figure 53: Table of Comparison of Time to Rupture and Estimated Time to Rupture for Grade 91 Large Specimen Cross-Weld Tests .....	50
Figure 54: Sketch of Cross-Weld Specimen Configuration for EPRI Tests [18] .....	51
Figure 55: Limit Analysis Maximum Principal Stress Plots on Symmetry Planes of EPRI 37.5 <sup>0</sup> and 10 <sup>0</sup> Samples.....	51
Figure 56: Comparison of Time to Rupture and Estimated Time to Rupture for EPRI Grade 91 Cross-Weld Tests [18].....	51
Figure 57: Predictions of Grade 91 Cross-weld Tests Show Strengthening Effect of Constraint for a Wide Range of Stress for Both Sets of Non-Standard Samples Analyzed .....	52
Figure 58: Seamweld HAZ Model Pipe OD = 762 mm, ID = 427 mm, Weak HAZ Width = 2 mm, Weld Semi-Angle = 10 <sup>0</sup> .....	53
Figure 59: Distribution of Inelastic Strain Prior to Collapse. High Strain is Localized in Bore.....	54
Figure 60: Distribution of MPS Prior to Collapse .....	54
Figure 61: Development of HAZ Stress Near OD with Creep Strain and Time.....	55
Figure 62: Calculation of Joint WSRF: Single Sided “U” Weld .....	55
Figure 63: “X-groove” Weld Geometry in 20” OD x 0.76” Thick Pipe.....	55
Figure 64: Position of Maximum HAZ Maximum Principal Stress .....	56
Figure 65: Calculation of Joint WSRF: “X-Groove” Configuration .....	57
Figure 66: Comparison of Reduction Factors Calculated From This Work (Ratio Between Standard Specimen Type IV-HAZ and BM Curves, BMSF, and WSRFs Calculated for Two Pipe Geometries) Compared to ASME Section I/B31.1 Seam-Weld WSRFs, and Japanese (Yoshida et al.) Analysis.....	58
Figure 67: Table of EPRI Database of Select Incidents of Major Cracking and Failure of Long Seam-Welded Piping.....	68
Figure 68: Table of Estimates of Strength Reduction Factors Reflected in the Best-Fit Average Larson-Miller Behavior of Laboratory Cross-Weld Data of Yoshida et al. [15] Compared with Approximate Average Behavior of Base Metal* .....	71
Figure 69: Table of Exposure Parameters Estimated for Long Seam-Welded Piping in Fossil Power Plants.....	74
Figure 70: Table of Estimation of Failure Rates .....	74
Figure 71: Table of Points of Interest on the Grade 22 Statistical Rupture Strength Distribution of Ref. [24].....	75
Figure 72: Table of Stress Level, $\sigma$ , in the Distribution of Grade 22 Rupture Strength, Corresponding to the Estimated Failure Rates of Figure 70.....	76
Figure 73: Basis for Universal ‘Presumptive’ Weld Factor from [37] .....	79
Figure 74: Weld Strength Reduction Factors and Applicable Notes for ASME Section I PG-26 [38]81	
Figure 75: Table of Weld Strength Reduction Factors for 316L(N) SS as Recommended by RCC-MR Code .....	87
Figure 76: Table of Weld Joint Coefficient and Corresponding Testing Group.....	88
Figure 77: Summary Table of Published Data Analyzed.....	90

Figure 78: As-Reported C-Steel Weldment and Base Metal Rupture Data [40], [41], [42], [43], [44] on a Larson-Miller Parameter (LMP) Plot Along with the ASTM DS 11S1 Plate [39] and the Curve-Fits to That Data.....92

Figure 79: Reproduction of Figure 78 Without the ASTM Data .....93

Figure 80: Base Metal and Cross-Weld Test Data Linear Fits Compared for Ex-Service Material Rupture Tests from Ray et al. [43] and Wilson WRC 32 [44].....94

Figure 81: All Weld Metal Data from B&W [45] and the Ex-Service Weld Metal Data of Ellis et al. [40] in Comparison with the ASTM DS 11S1 Plate Data and Curve-Fits on a Larson-Miller Parametric Plot, SR: Stress-Relieved.....95

Figure 82: Summary Table of Grade 11 Weld and Weldment Data from Ref [46].....96

Figure 83: Summary Table of Grade 22 Weld and Weldment Data from Ref [46].....96

Figure 84: Summary Table of 304H/308 Filler Metal & Weldment Creep-Rupture Data Sources...103

Figure 85: Summary Table of 304H/308 Filler Metal & Weldment Creep-Rupture Data .....105

Figure 86: Summary Table of 16-8-2 Filler Metal Data .....114

Figure 87: Summary Table of 316 Filler Metal Data.....116

Figure 88: Comparison Table of Chemistries for Coated Filler Metal Electrodes Used to Join the Three Grades of Alloy 800.....117

Figure 89: Comparison Table of Chemistries for Bare Filler Metal Electrodes Used to Join Three Grades of Alloy 800.....118

Figure 90: Summary Table of 800H Weld and Weldment Data.....120

Figure 91: The Distribution of the ORNL Rupture Data for Filler Metal (a), Weld Process (b), Test Temperature (c) and PWHT Temperature (d).....123

Figure 92: Project Outline.....241

Figure 93: Temperature Shift for Equivalent Material Properties .....248

Figure 94: Table of Temperatures Used to Shift Creep Properties in Gr. 22 Material Zones for the Baseline Case to Demonstrate the Methodology and Sensitivity of Various Parameters to WJIF's.....256

Figure 95: Summary of WJIF Solutions (Solid Lines) Compared to Relative Strengths of the Weak Zones (Dashed Lines). .....257

## FOREWORD

This publication was prepared by ASME ST-LLC and sponsored by ASME and EPRI. The project was conducted by EPRI under a cost-sharing agreement with ASME ST-LLC.

Longitudinal seam-welded, high-temperature piping, given its susceptibility to premature failure with sometimes catastrophic consequences, continues to be of concern. In an effort to provide additional safeguards at the construction phase, the ASME Board on Pressure Technology Codes and Standards (BPTCS) formed a project team to address the concern. To develop a consistent set of Code requirements on long seam-welded piping construction, the project team identified specific needs relating to laboratory data, field experience data, and methods for structural evaluation that could be used in developing the safeguards for use in the Boiler and Pressure Vessel Code and the B31 Power Piping Codes. These needs have been defined as (a) weld strength reduction factors that can be considered inherent to the materials and methods of construction; (b) weld joint influence factors that capture specifics of the structure; and (c) guidance for application of the weld strength reduction factor and the weld joint influence factor in design rules. Consistent with these needs as identified in ASME ST-LLC's request for proposal, this document is presented in three separate parts (reports) as follows.

### Part 1: Development and Application of Weld Strength Reduction Factors Guideline (Task 1b/3 project report)

This report ties the elements of Parts 2 and 3 into an application guideline. The guideline includes description of a framework for analyzing laboratory data and using the weld joint influence factor development methods. The Part 1 report provides examples of application to two weld/weldment databases for longitudinal seam welds, illustrating the usefulness of the methodology. The examples are for Grade 91 steel that is susceptible to weld heat-affected zone failure, and Grade 22 steel that has and continues to be used in long seam-welded piping construction. The results are compared with current Code rules, literature findings, and experience.

### Part 2: Literature Review, Industry Approach, and Data Compilation in Support of WSRF Development (Task 1a project report)

This report includes a compilation of laboratory and experience data on weldments for select materials of common use and interest – carbon steel, low alloy CrMo steels, austenitic stainless steels, Alloy 800/800H, and Grade 91. A critical part of this extensive database development was collecting relevant information not available to the ASME Code committees when allowable stresses were set for some of these materials. Also given in this report is a summary of approaches that have been taken in establishing weld strength reduction factors worldwide.

### Part 3: Development of Weld Joint Influence Factors (Task 2 project report)

The report describes an analysis tool to evaluate the creep rupture strength of a weldment relative to that of base metal, benchmarked against select cases of field experience and laboratory component testing. The methodology can be used for calculating weld joint influence factors for any practical combination of materials and weldment geometries in a relatively quick and computationally efficient manner, also allowing for use of relatively simple materials models readily available to designers.

This publication references the original project task reports that have been reproduced here in the three parts as identified above: Part 1-Tasks 1b and 3; Part 2-Task 1a; Part 3-Task 2.

(EPRI is acknowledged for supporting this publication. EPRI conducts research and development relating to the generation, delivery and use of electricity for the benefit of the public. An independent, non-profit organization, EPRI brings together its scientists and engineers as well as experts from academia and industry to help address challenges in electricity, including reliability, efficiency, affordability, health,

STP-PT-077: Development of Weld Strength Reduction Factors and Weld Joint Influence Factors for Service in the Creep Regime and Application to ASME Codes

safety and the environment. EPRI's members represent approximately 90 percent of the electricity generated and delivered in the United States, and international participation extends to more than 30 countries.

Established in 1880, the ASME is a professional not-for-profit organization with more than 135,000 members and volunteers promoting the art, science and practice of mechanical and multidisciplinary engineering and allied sciences. ASME develops codes and standards that enhance public safety, and provides lifelong learning and technical exchange opportunities benefiting the engineering and technology community. Visit (<https://www.asme.org/>) for more information.

ASME ST-LLC is a not-for-profit Limited Liability Company, with ASME as the sole member, formed in 2004 to carry out work related to new and developing technology. The ASME ST-LLC mission includes meeting the needs of industry and government by providing new standards-related products and services, which advance the application of emerging and newly commercialized science and technology, and providing the research and technology development needed to establish and maintain the technical relevance of codes and standards. Visit (<http://asmestllc.org/>) for more information.


# **PART 1: DEVELOPMENT AND APPLICATION OF WELD STRENGTH REDUCTION FACTORS GUIDELINE**

## **1 APPLICATION GUIDELINE**

### **1.1 Overview**

The purpose of the ASME-EPRI research project is to develop the methodology and data to help establish weld strength reduction factors (WSRF) for service in the creep regime for a wide range of materials with applicability to various sections of ASME Boiler & Pressure Vessel Codes. A review of how various codes address creep behavior of welded structures and pressure vessels in the Task 1a literature review [1] showed that no clear consensus exists between or even within various sections of codes around the world. The range of approaches include: no rules, requirements to follow ‘good engineering practice,’ simple factors on design irrespective of material, and factors on design which may depend on material, class/group of material, time, or combination of material and weld metal (based primarily on assessments of weld metal only data). ASME Section III-NH contains the most extensive set of rules for welded components based on design life, material and weld metal combination, and temperature. The origins of the strength factors applied in Section III-NH are primarily based, for stainless and nickel-based alloys, on the ratio of weld metal strength to base metal strength, the source for the chromium-molybdenum steels is not known, and the grade 91 values are biased on some cross-weld data with more recent data showing the assessment to be non-conservative at higher-temperatures and/or longer-times [1]. The applicability of these rules has been assessed for a few of the material-weld metal combinations by Corum [2] for a large body of structural ‘feature’ tests, and the results are provided in Figure 1. The figure shows that in all cases, the application of the Section III-NH rules to welds produced conservative lifetimes relative to measured life in the test, suggesting a material/material class grouping approach is appropriate for design purposes.

**Figure 1: Summary of the Ratio of Stress to Cause Rupture to the Calculated Minimum Stress from ASME Section III-NH (formerly N-47) Rules as a Function of Rupture Time for Structural Feature Tests on 316, 304, and 2 1/4Cr-1Mo Showing All Ratios, Regardless Of Material and Rupture Time, Are Greater Than 1, i.e. the Calculated Stresses Are Conservative [2]**

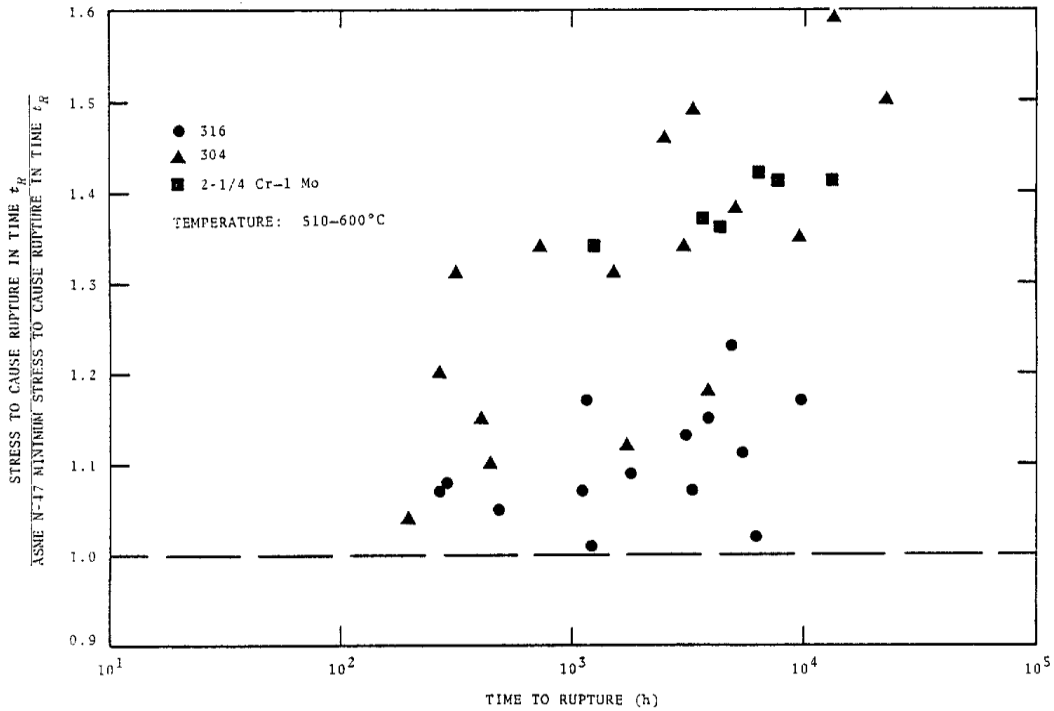

Most weld strength reduction factors (WSRFs) have been based on a relatively simple comparison of laboratory-measured material properties, but the application of these factors are to components or designs. How the weld affects the performance of the structure is critical to the success of any approach for developing and applying WSRFs. It should be also understood that the cross-weld creep-rupture test that has been employed for much of the recent laboratory testing around the world can be viewed as not only a material property test but a structural test as well. Therefore, specimen configuration can have an important impact on the test results. If cross-weld data are to be analyzed, the structural analysis used to evaluate the cross-weld data should ideally be the same as that to develop the WSRFs. Based on this discussion, it is clear that a modeling methodology/tool was necessary for this project.

In Task 2, a brief review of modeling method for creep of welded structures was provided [3]. Detailed finite element analysis (FEA) methods are routinely used for high-temperature creep assessment of structures. When applied to welded structures, the amount of input data is very high, often requiring material constitutive models for the various zones of the weldment such as: base metal, weld metal, coarse-grained heat-affected zones (HAZ), etc. Obtaining such data requires testing of materials heat-treated to simulate the zone processes or by specialized techniques. Therefore, very limited data exist for limited materials and test conditions. Considering the variability in material creep properties and welding processes, the suitability of broadly applying such data, which are not necessarily produced to recognized standards, is questionable. For cases involving life assessments of specific components, detailed FEA modeling with constitutive equations has been successfully employed. For design purposes, however, this type of FEA modeling is not easy to implement within current design codes, especially those based on design by rule approaches.