

AS 1428.1—1988



**Standards
Association of
Australia**



1993 ed.

Australian Standard® 1428.1—1988

DESIGN FOR ACCESS AND MOBILITY PART 1—GENERAL REQUIREMENTS FOR ACCESS—BUILDINGS



STANDARDS AUSTRALIA
Incorporated by Royal Charter

AMENDMENT No 1
to
AS 1428.1—1988
DESIGN FOR ACCESS AND MOBILITY
PART 1—GENERAL REQUIREMENTS FOR ACCESS—BUILDINGS

CORRECTION:

The 1988 edition of AS 1428.1 is amended as follows; the amendment(s) should be inserted in the appropriate place.


SUMMARY: This Amendment applies to Figure 15.

Published on 16 January 1989.

AMDT
No 1
JAN.
1989


Page 19. Figure 15.

Delete existing (a) and (c) and substitute:

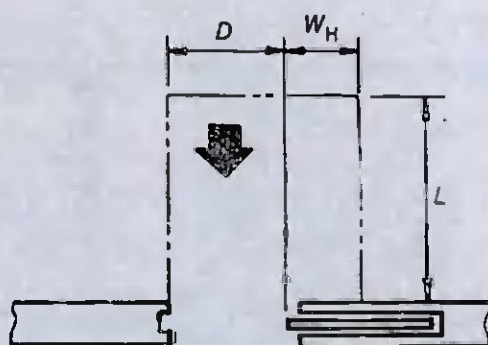

D	L	W _L	W _H
760	1 350	0	480
800	1 350	0	470
850	1 350	0	460
900	1 350	0	445
950	1 350	0	435
1 000	1 350	0	415

(a) Front approach

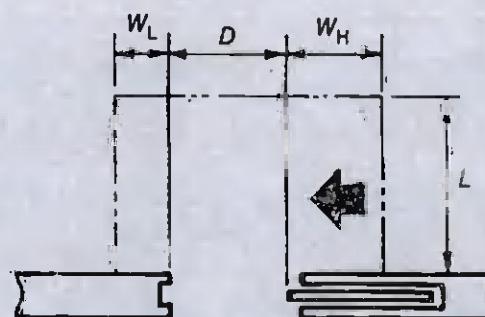

D	L	W _L	W _H
760	1 180	345	610
800	1 180	305	610
850	1 180	255	610
900	1 180	205	610
950	1 180	160	610
1 000	1 180	105	610

(c) Slide-side approach

STANDARDS AUSTRALIA

Amendment No 2
to
AS 1428.1—1988
Design for access and mobility
Part 1: General requirements for access—Buildings

REVISED TEXT

The 1988 edition of AS 1428.1 is amended as follows; the amendment(s) should be inserted in the appropriate place.

SUMMARY: This Amendment applies to Clauses 5.10, 5.13, 6.3(a), 6.8, 6.9(b), 8.1(d), 8.2, 11.2.3, 11.2.8 and Figures 4, 8, 11, 19 and 27.

Published on 13 October 1989.

AMDT
No 2
OCT.
1989

Page 5. Clause 5.10.

Delete existing definition and substitute:

5.10 Kerb ramp—an inclined accessway with a length not greater than 1520 mm and a gradient not steeper than 1 in 8, located within a kerb.

AMDT
No 2
OCT.
1989

Page 5. Clause 5.13.

Delete existing definition and substitute:

5.13 Step ramp—an inclined accessway with a length not greater than 1520 mm and a gradient not steeper than 1 in 8, located in, or instead of, a step other than a kerb.

AMDT
No 2
OCT.
1989

Page 6. Clause 6.3(a).

Delete existing Clause and substitute:

(a) The maximum gradient of a ramp exceeding 1520 mm in length shall be 1 in 14.

AMDT
No 2
OCT.
1989

Page 9. Figure 4.

Delete existing Legend and substitute:

LEGEND:

G = difference in gradient between Surfaces A and B
e.g. Surface A = 1:8
Surface B = 1:22
G = 1:12.56

θ = acceptable angle of approach for a maximum of 8 mm deflection of one wheel of a wheelchair.

NOTE: For intermediate values of G, take to nearest higher value in the table, e.g. 1:12.56 take to 1:14.

AMDT
No 2
OCT.
1989

Page 11. Clause 6.8.

Delete existing Clause and substitute:

6.8 Kerb ramps and step ramps.

6.8.1 Profile.

- (a) The design and construction of kerb ramps and step ramps shall be as shown in Figure 8.
- (b) The abutment of surfaces at the top and bottom of kerb ramps and step ramps shall be in accordance with Clause 6.7.
- (c) The sides of kerb ramps and step ramps shall be graded plane surfaces.

6.8.2 Location. Kerb ramps and step ramps shall be graded in the direction of travel as shown in Figure 7. Where an intersection allows pedestrian traffic to cross at any angle the kerb ramp shall be graded and carried around the quadrant as shown in Figure 7.

AMDT No 2
OCT. 1989

Page 11. Clause 6.9(b).


Delete existing Clause and substitute:

(b) Where doorways are at landings (see examples in Figure 9), the dimensions of the landings shall be in accordance with the requirements for circulation spaces at doorways in Clause 8.3.

AMDT No 2
OCT. 1989

Page 12. Figure 8.

Delete existing Figure and substitute:

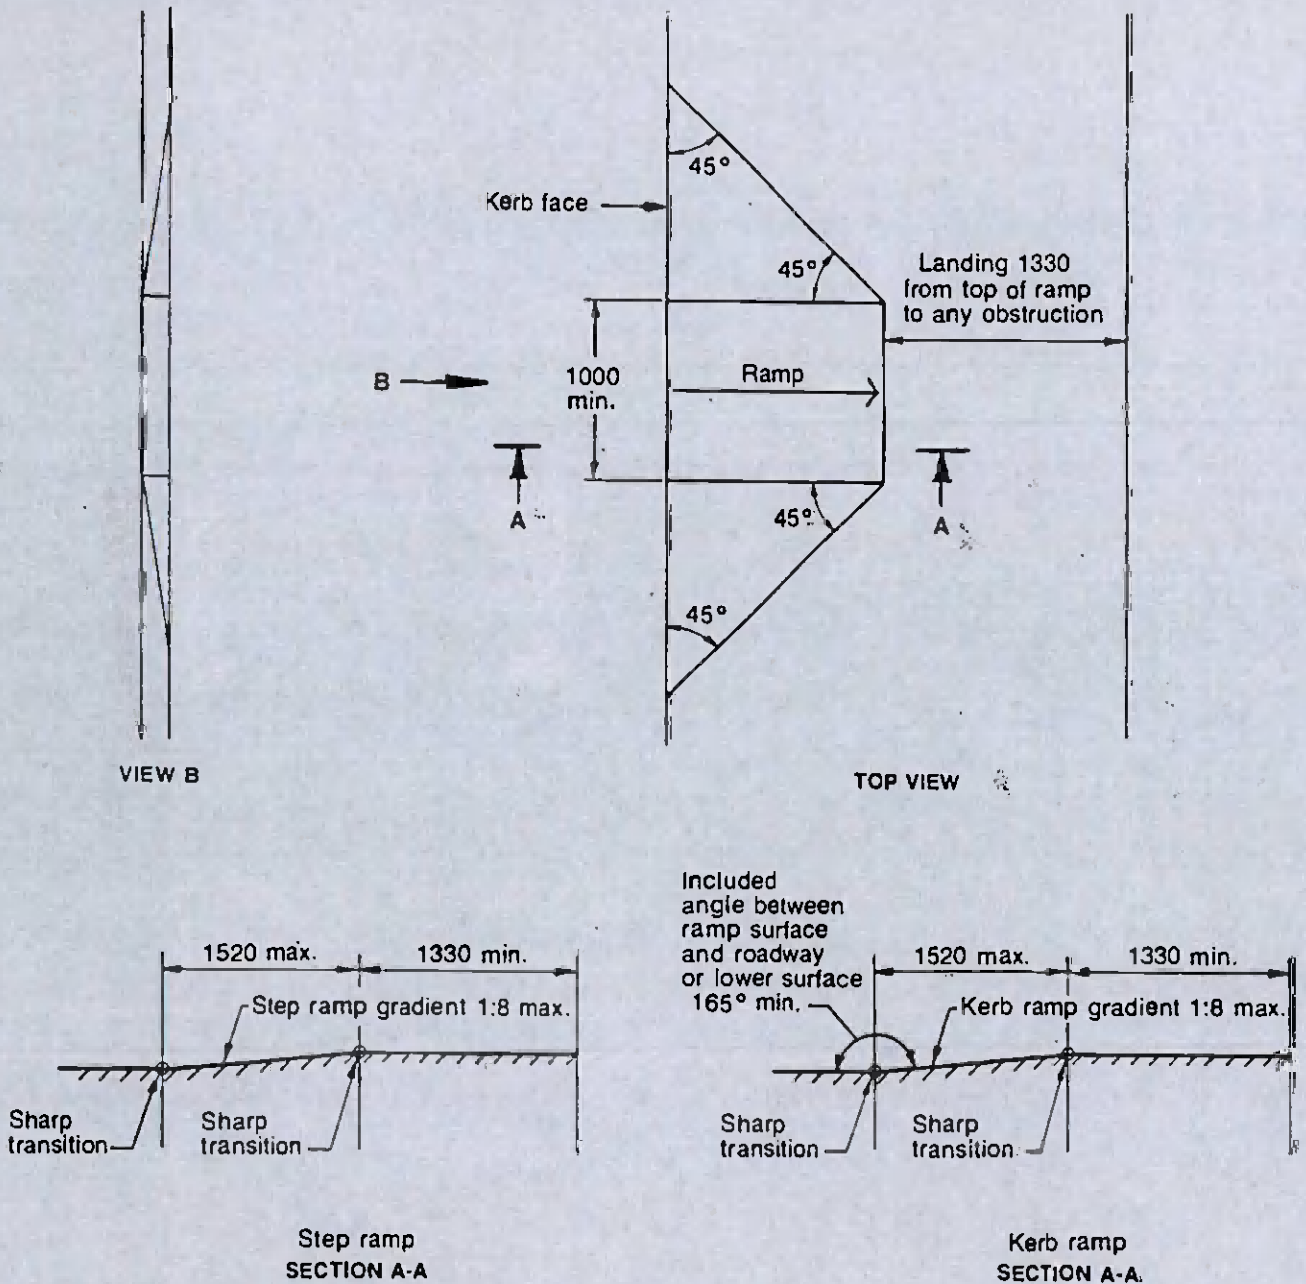

NOTES:

1. The ramp and sloping sides should be slip resistant and of a colour that contrasts with the adjoining surfaces.
2. A tactile indicator should be integrated and extended for 200 mm away from the ramp at the sharp transition at the top and bottom of the ramp. This could take the form of rough brooming or similar texture which will aid orientation for people with a visual impairment.

DIMENSIONS IN MILLIMETRES

FIGURE 8. KERB RAMPS AND STEP RAMPS

AMDT Page 15. Clause 8.1(d).

No 2
OCT.
1989


Delete existing Clause and substitute:

- (d) If a threshold is required, the height shall be not more than 35 mm and a ramp with a length of not more than 280 mm shall be provided (see Figure 11).
-

AMDT Page 15. Figure 11.

No 2
OCT.
1989

Delete existing Figure and substitute:

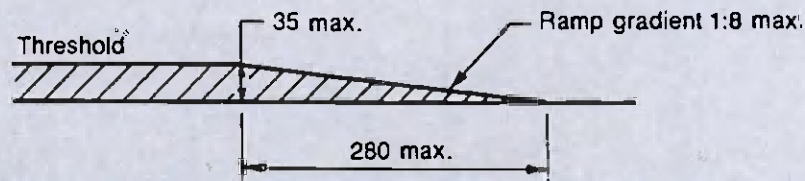

DIMENSIONS IN MILLIMETRES

FIGURE 11. RAMPED THRESHOLD

AMDT Page 15. Clause 8.2.

No 2
OCT.
1989

Insert new Note as follows:

NOTE: A wider doorway choice is desirable.

AMDT Page 22. Clause 11.2.3.

No 2
OCT.
1989

Delete existing Clause and substitute:

11.2.3 Cistern. The cistern may be either recessed or surface mounted. Surface mounted cisterns shall comply with Clause 11.2.8.

AMDT Page 22. Clause 11.2.8.

No 2
OCT.
1989

Delete existing Clause and substitute:

11.2.8 Circulation space in water closets. For each water closet the unobstructed circulation space from the finished floor to a height of not less than 900 mm shall be as shown in Figure 23. The toilet paper dispenser (see Clause 11.2.6), grabrails (see Clause 11.2.7) and the toilet pan are permitted in this space. A surface mounted cistern is also permitted in this space provided that the installation is within the dimensional requirements of Figures 19 and 20.

STANDARDS AUSTRALIA

Amendment No 3_a
to
AS 1428.1—1988
Design for access and mobility
Part 1: General requirements for access—Buildings

REVISED TEXT


The 1988 edition of AS 1428.1 is amended as follows; the amendment(s) should be inserted in the appropriate place.

SUMMARY: This Amendment applies to Figure 13.

Published on 7 May 1990.

AMDT
No 3
MAY
1990

Page 16. Figure 13.
Delete existing (d) and substitute:

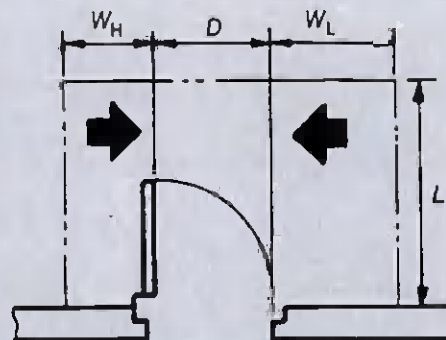

<i>D</i>	<i>L</i>	<i>W_H</i>	<i>W_L</i>
760	1 485	610	850
800	1 510	610	840
850	1 570	610	810
900	1 665	610	780
950	1 725	610	725
1 000	1 815	610	625

(d) Either approach,
door opens towards a user

AUSTRALIAN STANDARD

DESIGN FOR ACCESS AND MOBILITY
Part 1
GENERAL REQUIREMENTS
FOR ACCESS—BUILDINGS

AS 1428.1—1988

First published as AS CA52.1—1968.
Revised and redesignated AS 1428—1977.
Revised in part and redesignated AS 1428.1—1988.

PUBLISHED BY THE STANDARDS ASSOCIATION OF AUSTRALIA
STANDARDS HOUSE, 80 ARTHUR ST, NORTH SYDNEY, N.S.W.

ISBN 0 7262 5213 1

PREFACE

This Standard was prepared by the Association's Committee on Access for People with Disabilities to supersede (in part) AS 1428—1977, *Code of practice for design rules for access by the disabled*.

The revision of AS 1428—1977 was requested by the Australian Uniform Building Regulations Co-ordinating Council (AUBRCC) so that a Standard for access for people with disabilities into and within buildings would include only those items which could be covered by building regulations to be applied through the proposed Building Code of Australia. In consequence of this revision, the committee decided that initially AS 1428 should be divided into two parts, this Standard (Part 1) consisting of only those requirements for access which are to be regulated under the Building Code and Part 2, which will include other requirements for access which may or may not be regulated by other Authorities, and special requirements for purpose-built buildings. Part 2 is in course of preparation and is expected to be published within two years. Ultimately it is intended that Part 1 be used in conjunction with Part 2.

As a project for the 1981 International Year of Disabled Persons, a study was commissioned by AUBRCC to test those provisions of AS 1428—1977 that could be regulated. As a starting point for the study it was decided that convenient access for 80 percent of known adult wheelchair types (and hence wheelchair users) was an acceptable target. The concept of the 'A80' (adults/80 percent) wheelchair was then developed. The 'A80' test wheelchair is an adult size wheelchair which is representative of at least 80 percent of the manual and electric wheelchairs currently used in Australia, and its dimensions have been applied in determining minimum space requirements in this Standard.

The 'A80' test wheelchair dimensions are adopted as the minimum requirement for physical access as most other forms of mobility impairment can be accommodated within these dimensional parameters.

Because of the many different situations which may need to be addressed when designing buildings and facilities, it was seen as necessary for the Standard to provide a range of data so that the requirements for access can be met while allowing flexibility in design and when limitations are posed by other building conditions. The endeavour was to make the Standard a practical reference document for designers, particularly with regard to problem areas such as doorways and sanitary facilities. To assist in the designing of combined sanitary facilities, a set of transparent overlays for each sanitary facility, i.e. WC, washbasin, two-walled shower recess and three-walled shower recess, together with its required circulation space, has been provided with the Standard.

Because this Standard contains only those items which are able to be regulated by the proposed Building Code of Australia, some items such as lighting, shelving and wall units, signals and warnings and work surfaces which were included in AS 1428—1977 are not included in this Standard but will be specified in Part 2. Also because this Standard claims to meet only basic needs for minimum access, items such as water closets and shower recesses are included, while urinals and baths which are additional to what are considered to be minimum requirements, will be included in Part 2. Requirements for car parking and lifts are the subjects of separate Standards which are referred to in this Standard.

© Copyright — STANDARDS ASSOCIATION OF AUSTRALIA 1988

Users of Standards are reminded that copyright subsists in all SAA publications. Except where the Copyright Act otherwise allows, no part of this publication may be reproduced, stored in a retrieval system in any form or transmitted by any means without prior permission in writing of the Standards Association of Australia. Requests for permission should be directed to the Head Office of the Association. Where such requests relate to the reproduction of the whole or a substantial part of any Standard, permission may be conditional on an appropriate royalty payment.

CONTENTS

	<i>Page</i>
FOREWORD	4
1 SCOPE	5
2 PURPOSE	5
3 APPLICATION	5
4 REFERENCED DOCUMENTS	5
5 DEFINITIONS	5
6 WALKWAYS, RAMPS AND LANDINGS	5
6.1 GENERAL	5
6.2 WALKWAYS	5
6.3 RAMPS	6
6.4 ANGLES OF APPROACH FOR WALKWAYS, RAMPS AND LANDINGS	9
6.5 CURVED RAMPS AND WALKWAYS	9
6.6 CAMBER AND CROSSFALL IN RAMPS AND WALKWAYS	9
6.7 ABUTMENT OF SURFACES	9
6.8 KERB RAMPS OR STEP RAMPS	11
6.9 LANDINGS	11
7 HANDRAILS AND GRABRAILS	14
7.1 HANDRAILS	14
7.2 GRABRAILS	14
8 DOORWAYS, DOORS AND CIRCULATION SPACE AT DOORWAYS	15
8.1 PROVISION OF ENTRANCES	15
8.2 CLEAR OPENING OF DOORWAYS	15
8.3 CIRCULATION SPACES AT DOORWAYS	15
8.4 DISTANCE BETWEEN DOORWAYS IN PASSAGES	18
8.5 DOOR GLAZING (INCLUDING WALLS AND SIDELIGHTS)	18
8.6 DOOR CONTROLS	18
9 LIFTS	21
10 STAIRWAYS	21
10.1 STAIR GEOMETRY	21
10.2 STAIRWAY HANDRAILS	21
11 SANITARY FACILITIES	21
11.1 GENERAL INFORMATION	21
11.2 WATER CLOSETS	21
11.3 WASHBASINS	22
11.4 WASHROOM FIXTURES AND FITTINGS	22
11.5 SHOWERS	22
11.6 COMBINED SANITARY FACILITIES	23
12 CONTROLS	35
12.1 DOOR HANDLES AND HARDWARE	35
12.2 SWITCHES AND GENERAL PURPOSE OUTLETS (POWER POINTS)	35
12.3 WATER TAPS	35
13 FLOOR SURFACES	36
14 CAR PARKING FACILITIES	36
15 SIGNS	36
15.1 USE OF THE INTERNATIONAL SYMBOL	36
15.2 FORM OF THE INTERNATIONAL SYMBOL	36
15.3 FORM OF SIGNS	36
APPENDIX A. EXAMPLES OF COMBINED SANITARY FACILITIES USING MINIMUM SPACE	38

FOREWORD

Criteria for building and design Standards have been based on the assumption that the average person is middle-aged, healthy and ambulant. Only minimal provision, if any, has been made for people with disabilities.

In 1981 the Australian Bureau of Statistics published the result of a survey, 'Handicapped Persons in Australia—1981'. This survey found that 13.2 percent of the population had a disability and that approximately 8 percent of the population experienced mobility limitations.

These percentages are not necessarily constant owing to the continuously changing nature of our society. This is exemplified by the accelerating pace of our mechanized society, which results in increasing accident rates, and by decreasing birth rates and advances in medical science which are bringing about a greater proportion of older people in the community.

People with limited mobility face additional physical barriers to access to buildings and facilities.

The research study (see Preface) on which this Standard is based concentrated primarily on the needs of disabled people in the physical environment. In so doing it illustrated how provisions of access and facilities for disabled people could be integrated, in almost all cases, with those for the able bodied, thus minimizing feelings of segregation that may be experienced by disabled people.

STANDARDS ASSOCIATION OF AUSTRALIA

Australian Standard DESIGN FOR ACCESS AND MOBILITY

PART 1: GENERAL REQUIREMENTS FOR ACCESS—BUILDINGS

1 SCOPE. This Standard specifies minimum design requirements for elements of buildings and related facilities; in particular, access pathways, circulation spaces, and fittings, to permit access by people with disabilities.

NOTE: This Standard does not include all requirements for access for people with particular disabilities, or all requirements for buildings which are purpose-built for people with disabilities.

2 PURPOSE. The requirements established in this Standard are intended to permit general use of buildings and facilities by people with disabilities acting independently, or in the company of an assistant where a person's usual method of operation is with an assistant.

3 APPLICATION. This Standard is to be applied to the design of buildings and related facilities as required by the responsible Local, State or Federal regulatory body, other Standards, contract documents, and the like.

4 REFERENCED DOCUMENTS. The documents below are referred to in this Standard.

- AS
1172 Vitreous china water closet pans
1735 SAA Lift Code
Part 12: Facilities for persons with disabilities (AS 1735.12)
2208 Safety glazing materials for use in buildings (human impact considerations)
2700 Colour standards for general purposes
2890 Off-street parking
Part 1: Car parking facilities (AS 2890.1)
2899 Public information symbol signs
Part 1: General information signs (AS 2899.1)

5 DEFINITIONS. For the purpose of this Standard, the definitions below apply.

- 5.1 Shall**—indicates that a requirement is mandatory.
5.2 Should—indicates a recommendation.
5.3 May—indicates that a requirement is optional.
5.4 Angle of approach—the angle between the centre line of one path of travel and the centre line of an adjoining path of travel.
5.5 Circulation space—contains the net, unobstructed area for a minimum height of 2000 mm above the finished floor or ground surface (unless a clause in this Standard states otherwise), which is that space surrounding built elements, landscape elements, and fixtures and fittings required for movement into, and within buildings.
5.6 Continuous accessible path of travel—an uninterrupted path of travel to or within a building providing access to all required facilities. This accessible path

shall not incorporate any step, stairway, turnstile, revolving door, escalator or other impediment which would prevent it being negotiated by people with disabilities.

5.7 Grabrail—a rail used to give a steadying or stabilizing assistance to a person engaged in a particular function.

5.8 Handrail—a rail used in circulation areas such as corridors, passageways, ramps and stairways to assist in continuous movement.

5.9 Kerb—a side barrier to a trafficable surface.

5.10 Kerb ramp—an inclined accessway with a length not greater than 1200 mm and a gradient not steeper than 1 in 8, located within a kerb.

5.11 Landing—a flat or crowned surface with a gradient not steeper than 1 in 40.

5.12 Ramp—an inclined accessway with a gradient steeper than 1 in 20 but not steeper than 1 in 14.

5.13 Step ramp—an inclined accessway with a length not greater than 1200 mm and a gradient not steeper than 1 in 8, located in, or instead of, a step other than a kerb.

5.14 Walkway—any accessway with a gradient not steeper than 1 in 20.

6 WALKWAYS, RAMPS AND LANDINGS.

6.1 General. Walkways and ramps and landings shall have an unobstructed width of not less than 1000 mm and an unobstructed vertical clearance of not less than 2000 mm.

6.2 Walkways. The design and construction of walkways shall comply with the following:

- (a) Walkways shall be provided with landings as specified in Clause 6.9 at intervals not exceeding—
(i) for walkway gradients of 1 in 33 ... 25 m;
(ii) for walkway gradients of 1 in 20 ... 14 m; and
(iii) for walkway gradients between 1 in 33 and 1 in 20, at intervals which shall be obtained by linear interpolation.

NOTE: Landings are not required where walkway gradients are flatter than 1 in 33.

- (b) The gradient of walkways between landings shall be constant.
(c) Where at least one side of a walkway is bounded by—
(i) a kerb as specified in Clause 6.3(f) with a handrail as specified in Clause 6.3(e); or
(ii) a wall with a handrail as specified in Clause 6.3(e),

the intervals in (a) above can be increased by 30 percent.